


ACCD Exhibitor Services - Floor & Booth Layout

Event: 2011 TMC ITEXP0 Event Dates: 9/11/2011 to 9/15/2011 **Discount Deadline: 8/29/2011**

Utility Service Distribution Grid

- Please use grid should you not have a floor plan to submit.
- Mark the adjoining booth # or aisle for orientation
- Use the coordinates or the boxes as a scale for placement of services.
- Labor charges will be applied to your order form as outlined in our labor guidelines.


| Company Name | Booth Number |
|--------------|--------------|
| | |

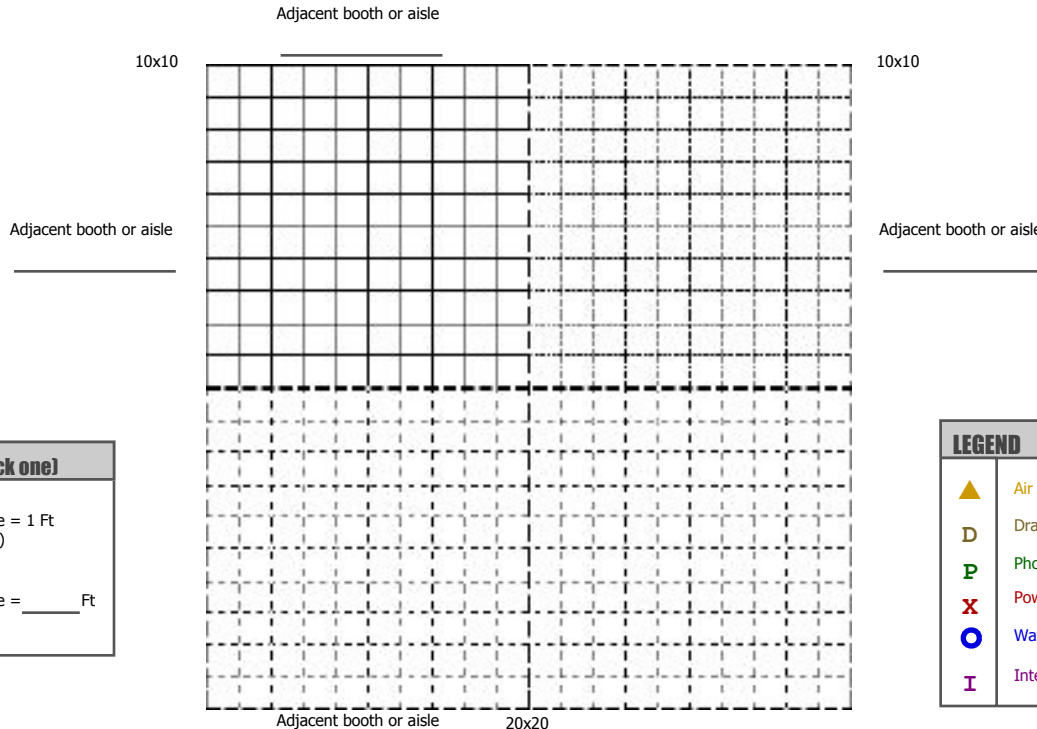

Service Access/Power Distribution Box Information

The Austin Convention Center has utility service access located in the floor 30' apart. These show up on the floor plan as small squares. Contact your Show Manager to obtain a show floor plan. A power distribution box spreads electrical power to the booths. It is approximately 24" x 18" x 6" with a 5' long, 2" thick cable plugged into the service hatch. We plug twist-lock extension cords in to the distribution boxes and run cords to your booth.

If its location is inconvenient, we can usually reposition the box or cover it. We can also remove it provided no other exhibitors are powered by it, but this restricts the amount of power we can deliver and may require sharing of electrical circuits. In addition, we will assess an additional charge for labor if you elect to have it replaced. Please call prior to your event if you have any questions.

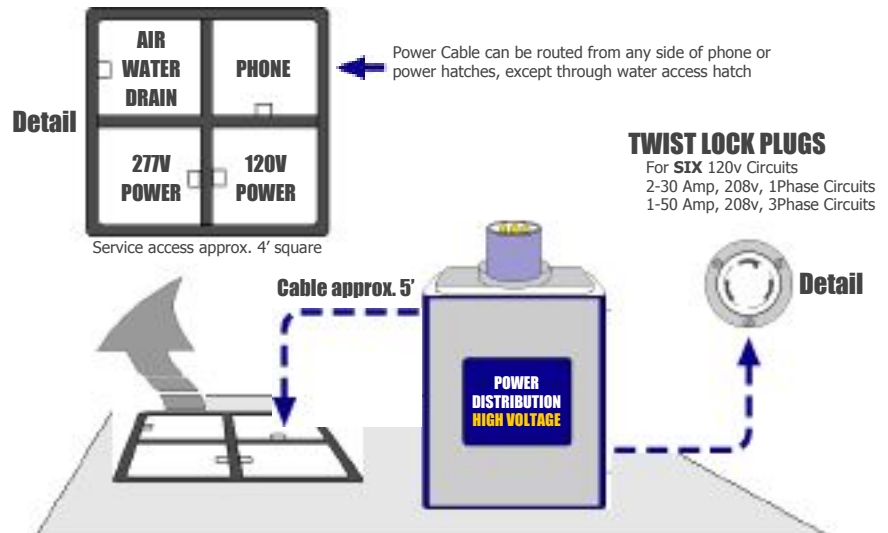

Art for illustration purposes. Not to scale.